


# Exit Capacity Planning Methodology Statement

## As required by Standard Special Condition A57: Exit Capacity Planning

January 2023

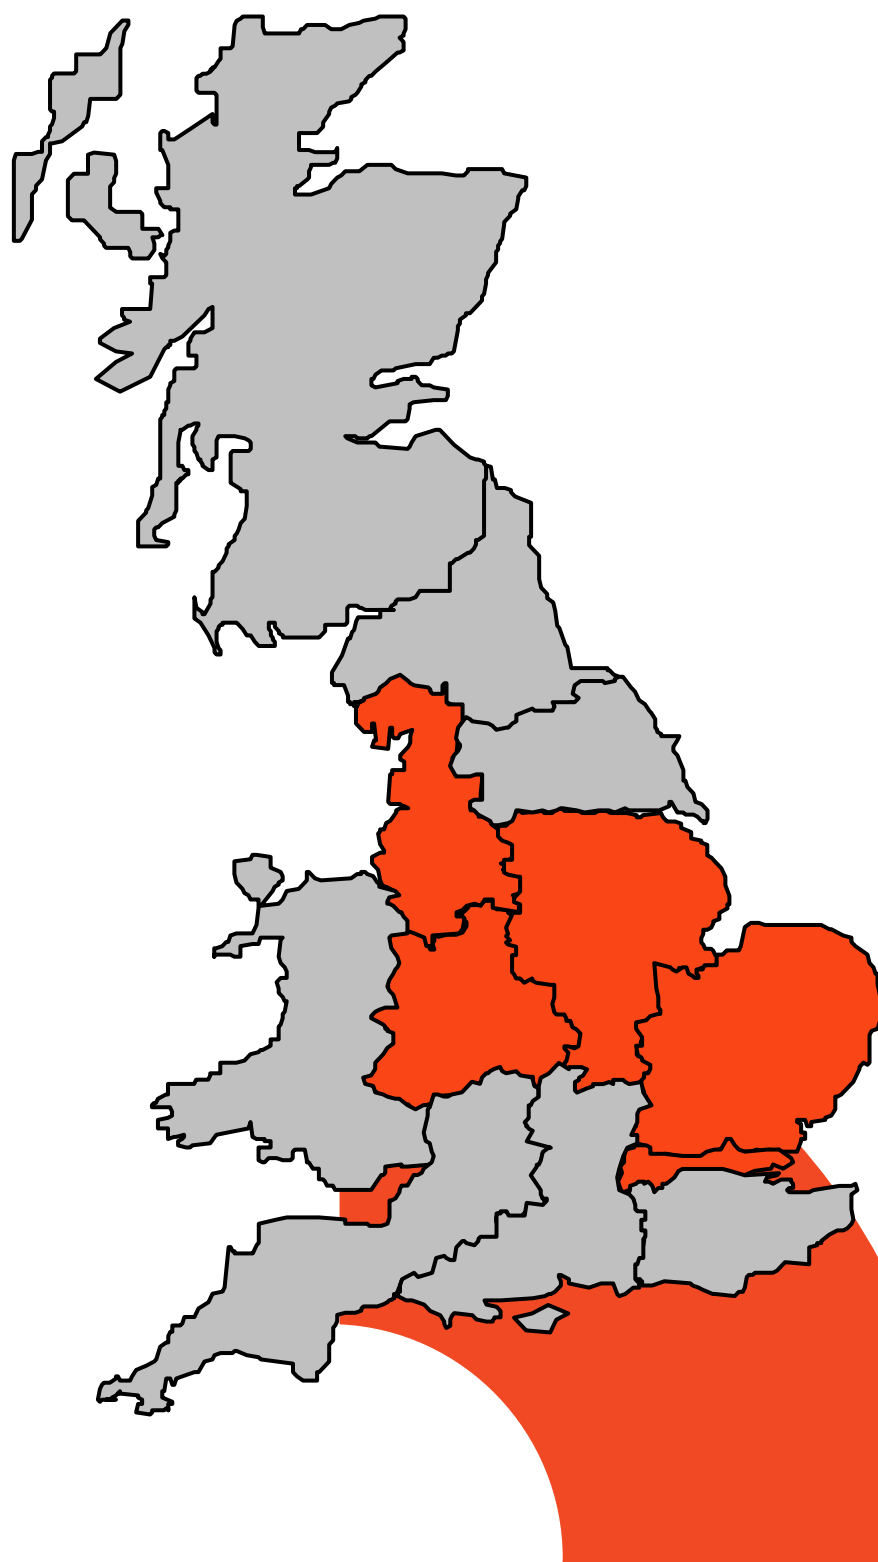

## Contents

Executive Summary.....	3
Objectives to Meet 1-20 Winters Demand.....	3
Methodology.....	4
Collection and Processing of Actual Demand Data.....	4
Pre-Forecast Data.....	4
Customer Engagement and Data Collection.....	5
DS8 Demands.....	5
Engagement.....	5
Load and Demand Forecasting.....	6
Demand Forecast.....	6
Offtake Parameter Statements, OPS.....	7
Interruption.....	7
Gemini Input.....	7
Final Review.....	7
Lessons Learnt session.....	7
Population of Network Analysis and Other Models.....	7
Strategy & Models.....	7
Network Specifics.....	8
Model Data.....	9
Consus Modelling.....	9
National Grid Assured Pressure Requests.....	9
Provision of the GDN Network Structure.....	9
Network Topologies.....	9
Publication of 1-in-20 and Other Forecasts.....	10
Forecasts.....	10
Methodology Publications.....	10
Methodology Statement.....	10
Appendices.....	11
Appendix A.....	11
Appendix B.....	12

# Executive Summary

## Overview

---

**The aim of this document is to satisfy the obligations comprised within the Exit Capacity Planning Guidance (ECPG) document, namely:**

- Publication of a methodology statement, setting out the process used to assess the requirements for NTS exit capacity, as set out in paragraphs 3.2 to 3.6

Cadent considers that the publication of this Methodology Statement, together with the detailed information that follows, meets the obligations as set out in the ECPG, which itself forms part of **Standard Special Condition A57: Exit Capacity Planning**.

### **Objectives to Meet 1-20 Winters Demand**

To meet our licence obligations, DN's book sufficient capacity to ensure that we are able to meet demand on the peak day in a 1:20 winter. Every Gas Year (1st October to 30<sup>th</sup> September), we are required to book exit capacity from the National Transmission System for each of our offtakes.

Every year Cadent receives from National Grid - Electricity System Operator (NG - ESO) four different demand scenarios and we have engaged with them to develop our forecast based on the "Falling Short" scenario. The other 3 scenarios are "System Transformation", "Consumer Transformation" and "Leading the Way".

NG - ESO provide a "Central Forecast" along with their 4 scenarios which they see is an accurate forecast for the level of expected demand in each distribution network, which aligns to our views based on the "Falling Short" scenario. The central forecast is a five-year forecast.

Our approach meets the 1:20 peak day obligation with a combination of Enduring and Annual capacity products and addresses the risk that daily capacity products may not be available in the event of an NTS constraint being called.

# Methodology

## How we run the process

---

### Collection and Processing of Actual Demand Data

#### Pre-Forecast Data

Cadent shall provide the following for each LDZ under its control, all data provided by Xoserve:

1. Actual consumption and shrinkage during previous calendar year corrected to the Seasonal Normal CWV conditions (using the NDM algorithms) with throughput broken down into the following categories:

- NDM 0 to 73.2MWh per annum
- NDM 73.2 to 732MWh per annum
- NDM >732MWh per annum
- DM
- Shrinkage
- Peaking Power Plant data
- Total LDZ

These volumes should take account of adjustments made in respect of individual site and aggregate NDM reconciliation, including (if appropriate) the re-phasing of such adjustments into earlier years.

2. Confirmation of the total number of new loads connected in each LDZ in the previous calendar year, and the number of loads in aggregate at the end of the year, split between domestic (0 to 73.2MWh p.a.) and non-domestic (>73.2MWh p.a.) categories. By early January the team will carry out a review of all the new large loads that have been accepted over the previous year.

3. Details of any load consuming/expected to consume >58.6GWh per annum provided by Xoserve, that:

- Has been connected in the previous calendar year; or
- Is expected to be connected to LDZ networks in the ten-year forecast period
- Information concerning any known or expected changes to any existing loads consuming >58.6GWh per annum

Each year we take the monthly flow data for the largest / most impactful sites in each network and compare it with the historic data to look for trends. Specifically, we look at:

- Annual demand
- Max daily
- Avg. daily

These figures are compared with the results from the previous years to determine if the demand is largely the same as previously or if it is trending in a particular direction, and if the actual demand is in line with the AQ and SOQ. These forecasts are then applied to these sites for the modelling for the coming year.

The sites chosen are not necessarily the largest in each network but are those that would have the most impact if their demand underwent a significant change, for example because they are at an extremity of the network.

A draft of the DS8 Large Load Data is then created. This report is needed for a) us to add these loads to our models with the appropriate demand levels and b) for National Grid to use in their demand forecasting. The data is checked to ensure that the correct data has been used and that any judgement-based decisions are defensible and appropriate to that demand.

The information provided in relation to such demands includes, as appropriate, expected 1-in-20 peak day demand, annual demand, supply type, category/nature of load, date of first gas flow and any associated phasing or build-up of demand over time.

xoserve will send through more info for the pre-forecast to the DN. Again, this is needed for the National Grid forecasting team. This data incorporates the weather corrected demand by Load Band, processed and unprocessed reconciliation and the numbers of new domestic and non-domestic connections. Also included is the supply point count at the end of the year. All this data is split by LDZ.

All of the required information from the business and xoserve are sent through to the National Grid Demand Forecasting team for them to assess during the forecasting process. The files sent across will be The DS8 spreadsheet, the LTS Quoted UIP and Non-Standard report from the Connections report and the Pre-Forecast information from xoserve.

## **Customer Engagement and Data Collection**

### **DS8 Demands**

If a customer is significant enough to have a substantial impact on the network, then we will talk to them with regards to their demand and usage patterns across the day / year. This engagement can take the form of questionnaires to the user and 'face to face', virtual discussion as required. These loads are known as DS8 demands.

### **Engagement**

This is a vital part of the process to ensure that we have all the data that we need to carry out our demand forecasting, modelling and offtake bookings as efficiently as possible. If we don't have accurate information on specific large loads for example, the distribution of demand on the models may be inaccurate and capacity could be booked inaccurately.

Each year in the middle of March we have bilateral meetings to discuss the pre forecast data and receive an overview from NG – ESO of the draft forecast. This is always subject to change as we do not receive the final version of the demand forecast until May.

Meetings are held with National Grid at several stages of the process and 3<sup>rd</sup> parties are invited to attend as observers to all of these as per the new ECPG requirements. These meetings cover the expectations of the Demand Forecast, the expectations of our booking requests, the likely response to the Assured Pressure Requests, the response to the bookings requests and changes to accommodate rejections of the requests where needed.

## Load and Demand Forecasting

### Demand Forecast

We receive our demand forecast from NG - ESO within May each year. The forecasts are produced by NG - ESO in line with the FES process. Details on how this is done can be found in [NG's Gas Demand Forecasting Methodology](#) document, under the heading 'Gas operations documents (2)', and the [FES Modelling Methods](#) document.

These files will be emailed by NG - ESO. Between the months January – March information is exchanged, and bilateral meetings are held to determine data requirements and information exchange. External observers are invited to these bilateral meetings.

Every year DNs receive from NG - ESO four different demand scenarios and a central forecast and engage with them to either develop the forecast or develop their own based on an in-house demand forecasting process.

All DN demand forecasting methodologies are subject to a governance process and when approved is modelled and determines our peak day 1:20 requirement.

### Governance

In 2015 National Grid Distribution commissioned an independent study of the NTS Demand Forecasting Methodology to gain assurance that the methodology would produce credible demand scenarios.

The Smith Institute was asked by National Grid to conduct an independent review of the technical basis of the 1 in 20 peak demand forecasting, and so underpin the confidence of the Network Strategy team in the use of such forecasts for booking year-ahead gas capacity.

The conclusion drawn by The Smith Institute was that the methodology used to generate the 1 in 20 peak demand forecast is fit for purpose. There were recommended improvements to enhance the model performance which were accepted by NTS.

A full governance exists for this process and checks are carried out at each step of the way to ensure the correct steps are taken and that the correct data is used.

Annual business sign off occurs following internal challenge and review sessions.

## Offtake Parameter Statements, OPS

This tells the corresponding DN how much gas we are expecting to use through the transfers to / from their LDZ. The amounts are based on the modelled data. Assurance checks are completed.

## Interruption

This is a commercial tool administered annually by Xoserve or driven ad-hoc by the DNs. It is used to alleviate network constraints and as an alternative to network reinforcement. Xoserve will provide the information on the eligible sites within a DN, these are those sites that have an AQ greater than 200k therms or 58.6 GWh per annum. Eligible sites within the DN interruption zone can bid in for interruptible contracts as per UNC and process outlined on the joint office here:

<https://www.gasgovernance.co.uk/int>

## Gemini Input

When the Peak Day models have been finalised, the offtake Flat, Flex & Pressure figures are put into Gemini for the next 6 years. There are 3 parts to the Gemini input; reductions to current flat enduring bookings, increases to flat bookings and an input of flex and pressure data as per the UNC process, which can be found here:

[UNC TPD B3](#).

If needed, after engagement with National Grid, changes can be made to the data in Gemini to reflect the position agreed. If the requests are affected by substitution, then NG need to get acceptance of this from Ofgem. In this case the values will not be confirmed in Gemini until November or December. Assurance checks are completed at each step of the booking request process

## Final Review

A check is made that all previous steps have been carried out fully and correctly and that all strategies are in place for the winter period. Any network settings that are different for the summer and winter periods are also checked to ensure that the required changes have been made or are scheduled to be made at the appropriate time.

At this time a check of the ECPG will be made to ensure that we have been fully compliant with every requirement.

## Lessons Learnt session

This ensures that all process documents used are up to date and are still fit for purpose and that any lessons learnt are documented for future years.

## Population of Network Analysis and Other Models

### Strategy & Models

A strategy is agreed with the ECC and Operations. This will determine where we book gas into the LTS, pressures differentials across the network at start of day,

where flex will be taken, if there are any pressure restrictions that need to be taken into account.

A spreadsheet is created to store the data from the network analysis models, to calculate any additional storage needed to meet the Consus, (see below for explanation of this tool), requirement that is not needed on the model, and to verify that no offtake goes above its physical capacity or Baseline amount.

The base model in network analysis is scaled to the agreed demand level and balanced as per the strategy. The results are stored in the spreadsheet mentioned above.

Models are also created for D13, D46, D150 & D300. This is done by scaling down the peak model to the D13 demand level, then scaling the D13 model to D46, etc. These are needed for the Section H spreadsheets which are sent to NG NTS.

The network analysis network analysis model uses the following flow equations; Smooth Pipe Law, Panhandle A and Redlich–Kwong. These shall be used with the appropriate efficiency and roughness factors relevant to the network being evaluated

All the results are saved in the spreadsheets and a check is carried out to ensure that the models have been built and balanced correctly and in line with the agreed strategy. Assurance checks are carried out.

### **Network Specifics**

**EA** – This is a very rural network with small pockets of demand rather than large population centres. Several parts of it are fed from isolated sources under pressure control, the rest is volumetric control. There are relatively few large loads on this network and even less customers directly connected to the LTS. There are a large number of sustainable entry connections, but these are not taken into account in our peak day bookings.

**EM** – This network has areas of higher demand and industry as well as customers connected directly to the LTS. Most of the network is controlled volumetrically with some pockets of pressure control. There are a large number of sustainable entry connections, but these are not taken into account in our peak day bookings.

**NL** – This is a densely populated area, but it has minimal customers directly connected to the LTS and minimal sustainable entry connections

**NW** – This network is highly industrialised in parts and very rural in others. It is volumetrically controlled with only 1 small section of pressure control. It has many directly connected customers and several sustainable entry connections which are not taken into account in our peak day bookings.

**WM** – This is similar to the NW in that it has areas which are highly populated and industrialised and others which are very rural. There are some directly connected customers and several sustainable entry connections which are not taken into account in our peak day bookings. It is mainly controlled volumetrically.



## Model Data

Data for the Network analysis models comes from different sources; the Pipeline Safety Regulations (PSR) records, uplift of demand from the <7bar network analysis models, the Interruption Eligibility data from xoserve and the DS8 data.

Physical pipe and Offtake/PRI data parameters contained within the model is reviewed and updated on an annual or ad-hoc basis throughout the year. The team will request the relevant information from appropriate departments in the business or be informed of a change as part of the project closure process. This is to ensure that the network analysis models are as accurate as possible. A full physical validation of the model can be carried out if required using PSR and other Data.

Flow data from all the sources on the <7bar network analysis models supplied by an LTS feed is added to the LTS network analysis models. This data provides the basis for the demand distribution on the network analysis models. Assurance Checks are completed.

The DS8 data is used for demands that can have a significant effect on the network on their own. This could be due to size, location, or both. Files are created for all demands that are to be added to the network analysis models, whether from network analysis, the Interruption data or DS8 data.

## Consus Modelling

Consus is a storage simulation tool that is used to determine the amount of storage required at a given demand level. Two data files are needed for each LDZ from the control room SCADA system. These are Hourly Demands and FE Data (Forecast Error). The remaining data comes from the demand forecast supplied by National Grid, (LDEM & Peak Day Forecast), and a file downloaded from the National Grid Data Item Explorer on their website (historic CWV) or via Xoserve's data files.

The files are loaded into the Consus application supplied by DNV and the tool is run. The report produced by the tool is saved for audit purposes and the results used to determine the storage level required for the coming winter. Assurance checks are completed.

## National Grid Assured Pressure Requests

National Grid Gas send a formal request for reductions in the assured pressures at various offtakes. This is to help them run their network more efficiently. These are assessed against the capacity of the site and the need for linepack / storage and a formal reply is sent.

## Provision of the GDN Network Structure

### Network Topologies

This information was provided to Ofgem and NG and published on Cadent's website in line with the timescales within the ECPG. They can be found [here](#).

## Publication of 1-in-20 and Other Forecasts

### Forecasts

The forecast is published on Cadent's website and can be found [here](#) in the Long Term Development Plan, (LTDP), which gives details of longer range forecasts and historic demands.

Approved topology forecasts are provided to NG and Ofgem but not published externally due to CNI considerations.

## Methodology Publications

### Methodology Statement

This ECP Methodology Statement document is intended to fulfil the requirements set out in sections 3.22 and 3.23 of the ECPG.

# Appendices


## Appendix A

The full Exit Capacity Planning Guidance Document can be found [here](#) on Ofgem's website.

## Appendix B

The diagram below is a high-level flow diagram for this process.

# ECPG Annual Calendar of Actions

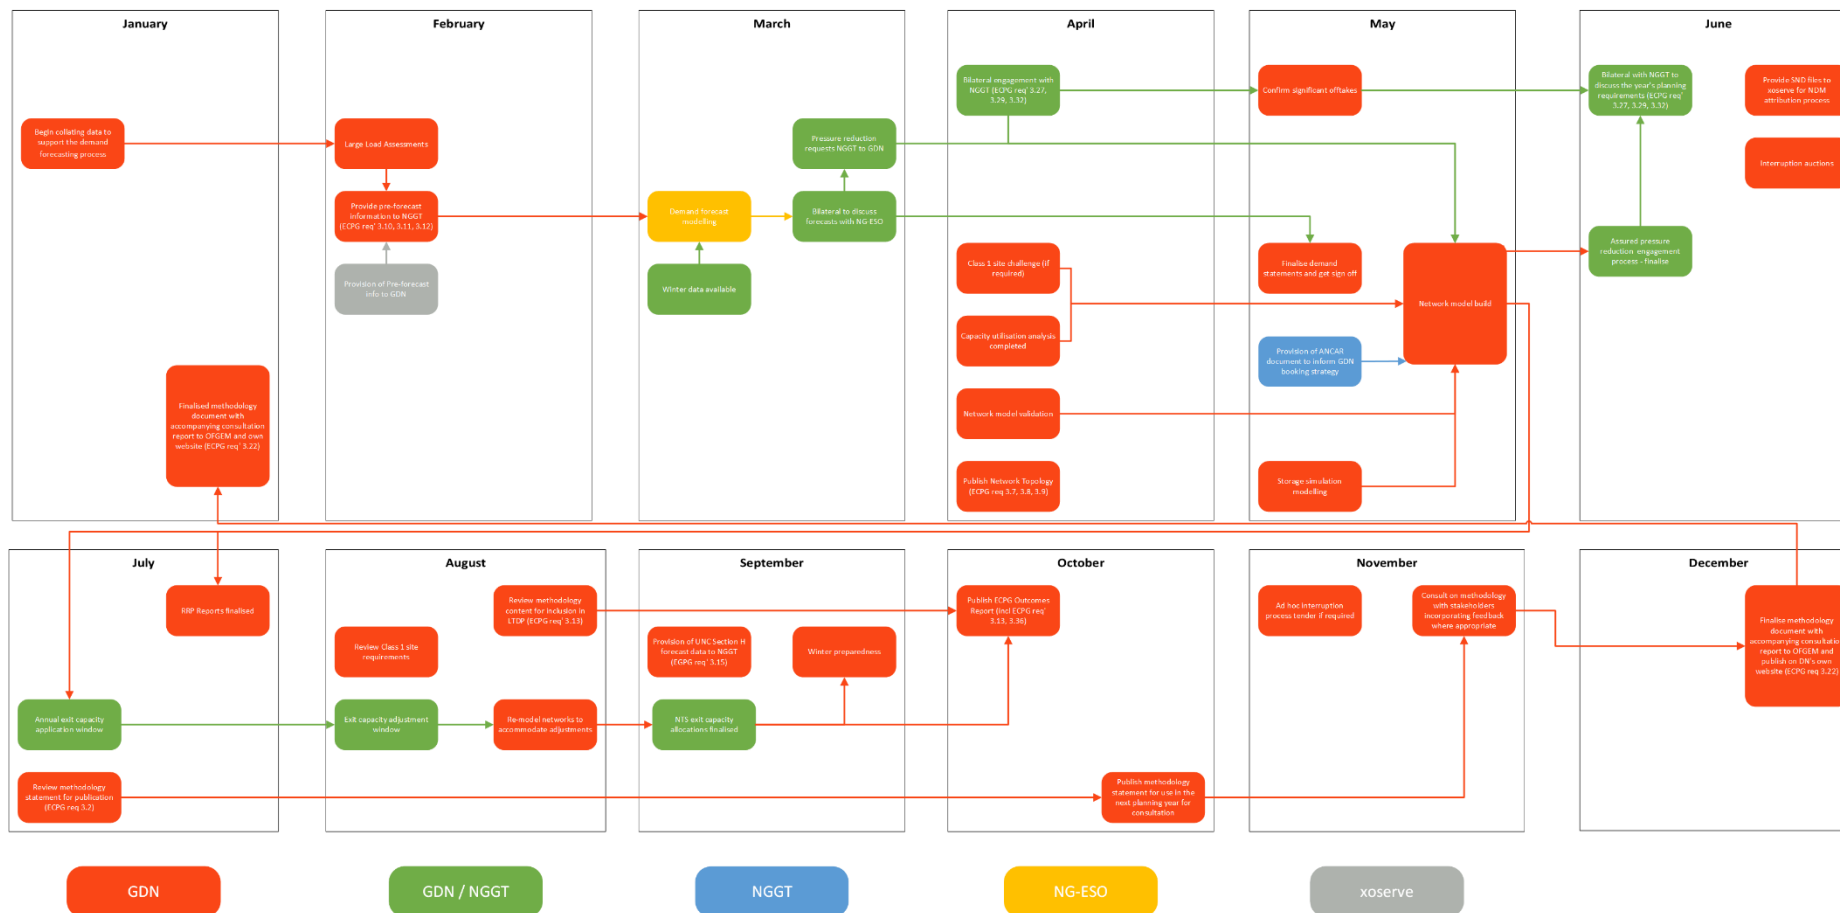

**For all feedback or queries, please contact:**

Chris Jones  
ECC Manager  
Cadent  
Pilot Way  
Ansty Park  
Coventry  
CV7 9JU

Email: [LTSPPlanning.AnalysisRequests@cadentgas.com](mailto:LTSPPlanning.AnalysisRequests@cadentgas.com)